



Drinking Water Quality Management System

OPERATIONAL PLAN

FOR

RICHMOND HILL DISTRIBUTION SYSTEM



Richmond Hill Drinking Water

Town of Richmond Hill
QMS Operational Plan 4.3

Table of Contents

1.0	Quality Management System	1
2.0	QMS Policy	3
3.0	Commitment and Endorsement	3
4.0	QMS Representative	4
5.0	Document and Records Control	5
6.0	Drinking Water System Description	6
7.0 & 8.0	Risk Assessment & Risk Assessment Outcomes	6
9.0	Organizational Structure, Roles, Responsibilities and Authorities	7
10.0	Competencies	8
11.0	Personnel Coverage	8
12.0	Communications.....	9
13.0	Essential Supplies and Services.....	11
14.0	Review and Provision of Infrastructure	11
15.0	Infrastructure Maintenance, Rehabilitation and Renewal.....	12
16.0	Sampling, Testing and Monitoring	12
17.0	Equipment Calibration and Maintenance	13
18.0	Emergency Management	13
19.0	Internal Audits.....	14
20.0	Management Review	14
21.0	Continual Improvement	15
DEFINITIONS		16
HISTORY OF CHANGES.....		17
Appendix 'A': QMS Policy		20
Appendix 'B': Top Management Signed Commitment and Endorsement Form		21
Appendix 'C': Council Endorsement		22
Appendix 'D': QMS Representative Authorization and Appointment		23
Appendix 'E': Drinking Water Description and Flow Chart		24
Appendix 'F': Org. Chart; Roles, Responsibilities, Authorities and Competencies		28
Appendix 'G': QMS Personnel Coverage Table		38
Schedule "C"		39

*The *Safe Drinking Water Act, 2002*, requires the inclusion of Schedule “C” from the Director’s Directions in all Operational Plans.

1.0 Quality Management System

[Return to Table of Contents](#)

1.1. Requirement

Element 1 of the Drinking Water Quality Management Standard (DWQMS) requires the Town of Richmond Hill (“the Town”) to establish and maintain a [Quality Management System](#) (QMS) that conforms to the standard, and to document this QMS in an Operational Plan.

1.2. Operational Plan

This document is the Town’s Operational Plan for its drinking water QMS. It provides a short summary of the system that describes how the QMS meets the requirements of the DWQMS. More detailed QMS documents, such as Element Procedures, and Standard Operating Procedures, can be appended as required.

The Operational Plan is the primary instrument for communicating the Town’s QMS from staff to Council, and from Council to Ontario’s Ministry of Environment and Climate Change (MOECC) and to the Richmond Hill public. It is endorsed by QMS Top Management and Town Council, accredited by a provincially-appointed Accreditation Authority and approved by the MOECC.

1.3. Scope

a. Drinking Water System

The Town owns a stand-alone drinking water distribution system. This system receives potable water at transfer points from York Region watermains and distributes it to service connections for customer consumption and to hydrants for fire protection. Quality Management System policies and procedures govern those activities and services performed by the Town, as the system’s operating authority, that relate to drinking water.


The Town’s Community Services Department, Public Works Division, maintains a network of watermains and related valves, hydrants and meters. Trained and certified Public Works staff perform preventative and operational maintenance on this infrastructure, and take regular water samples for lead, chlorine residual, disinfection by-product, and microbiological testing. Engineering staff from the Environment & Infrastructure Services Department design and construct new watermains as part of an ongoing Capital Replacement program. Watermains added as part of new subdivision development are reviewed and approved by the Planning and Regulatory Services Department. Municipal Inspectors ensure all applicable standards are met when new watermains are connected to the existing network.

b. Personnel

The DWQMS prescribes roles and responsibilities for the drinking water system owner and operating authority, including Top Management. Accordingly, the scope of the Town of Richmond Hill’s QMS extends to the following:

- Town of Richmond Hill Council (System Owner)

- Community Services (CS) Department– Public Works Operations Division
- Environment & Infrastructure Services (EIS) Department – Design and Construction Division (Project Managers-Capital Infrastructure and Municipal Inspections)
- QMS Top Management:
 - Commissioner of Community Services Department
 - Director of Public Works Operations
 - Manager of Water & Wastewater
 - Manager of Construction
 - Manager of Design
 - QMS Program Coordinator

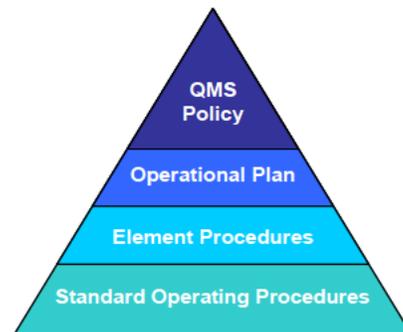

1.4. Documentation

The QMS Policy and Operational Plan are public documents that set broad commitments and establish the framework for Richmond Hill's QMS. Internal documents such as procedures, tables, and forms are organized into three levels and are located and coded according to the format below:

Document Type	Section	Number	Example
<u>Level 1:</u> EP (Element Procedure) – correspond to the ‘plan’ requirements of the DWQMS and demonstrate how the QMS conforms to the provincial standard <ul style="list-style-type: none"> • Reviews and outcomes required by certain Element Procedures are included as attachments to those procedures 	DW (Drinking Water)	1, 2, 3, etc.	EP-DW-5 Infrastructure EP-DW-5 Attachment 1: Infrastructure Process Flow Chart
<u>Level 2:</u> SOP (Standard Operating Procedure) – umbrella document for a category of work activities <ul style="list-style-type: none"> • WI (Work Instruction) – specific instructions for an activity under a category of work Forms – used to capture output of an activity (not coded)	DW (Drinking Water)	1, 2, 3, etc. 1.2, 4.5, etc.	SOP-DW-3 Water Quality WI-DW-3.1 Water Samples
<u>Level 3:</u> Records and Other Documents (not coded)			

1.5. Associated Documents

- WI-DW-4.3 *Operational Plan*

2.0 QMS Policy

[Return to Table of Contents](#)

2.1 Requirement

Element 2 of the DWQMS requires the inclusion of a QMS Policy in the Operational Plan. The Policy must be appropriate for the size and type of drinking water system, and must state commitments to:

1. maintain and continually improve a QMS
2. provide safe drinking water to the consumer
3. comply with all applicable legislation and regulations

The Policy must also be accessible to all QMS personnel, Council, and the public.

2.2 QMS Policy

The QMS Policy is developed by the QMS Team and approved by QMS Top Management before being communicated to Council. The Policy is reviewed on an annual basis to ensure accuracy and currency, and is revised as needed. It is available to applicable staff electronically through Intelix, and to all staff and the public through the Town's website and Town facilities.

[Appendix 'A'](#) contains Richmond Hill's Drinking Water QMS Policy.

2.3 Associated Documents

- None

3.0 Commitment and Endorsement

[Return to Table of Contents](#)

3.1 Requirement

Element 3 of the DWQMS requires written endorsement of the Operational Plan from QMS Top Management and Council. As well, it requires Top Management to ensure a QMS is in place, ensure QMS personnel are aware of applicable legislative and regulatory requirements, communicate the QMS as required, and determine, obtain or provide resources to maintain and continually improve the QMS.

3.2 Top Management Commitment and Endorsement

Top Management must sign and date a Commitment and Endorsement form that clearly expresses endorsement of the Operational Plan and commitment to fulfilling its requirements. Evidence of this commitment is achieved primarily through the Management Review process, and by appointing and supporting a QMS Representative.

- a. Top Management shall ensure the QMS is in place and in conformance with the provincial standard through *EP-DW-7 Management Review*.
- b. Top Management shall ensure appropriate personnel are aware of all applicable legislative and regulatory requirements through Operational Plan Element 4: *QMS Representative*.

- c. Top Management shall communicate the QMS according to *Operational Plan Element 12: Communications*.
- d. Top Management shall, to the best of its ability and subject to budget approval, determine, maintain, or provide the necessary resources for maintaining and continually improving the QMS through *EP-DW-7 Management Review*.

[Appendix 'B'](#) contains Top Management endorsement of the Operational Plan.

3.3 Council Endorsement

Council receives the Plan or its updates through an annual staff report, and endorses it by enacting a confirmatory by-law as contained in official Council meeting minutes. The QMS Representative shall ensure Council endorsement is received for the most current Operational Plan following changes in Council due to elections or otherwise.

[Appendix 'C'](#) contains Council endorsement of the Operational Plan.

3.4 Associated Documents

- WI-DW-4.2 *Reports to Council*
- WI-DW-4.3 *Operational Plan*

4.0 QMS Representative

[Return to Table of Contents](#)

4.1 Requirement

Element 4 of the DWQMS requires Top Management to appoint and authorize a QMS Representative to carry out the following:

- Administer the Quality Management System by ensuring that applicable processes and procedures are established and maintained;
- Report QMS performance and need for improvement to Top Management;
- Ensure the use of the most current versions of QMS documents;
- Ensure personnel are aware of applicable legislative and regulatory requirements;
- Promote awareness of the QMS throughout the Town.

The QMS Representative must be identified in the Operational Plan.

4.2 QMS Representative

Top Management ensures a QMS Representative is in place to manage the QMS. A full-time, permanent position within the Public Works Division, titled 'QMS Program Coordinator', has been created and approved to fulfill the QMS Representative duties. A Top Management member must sign and date a form confirming the appointment.

[Appendix 'D'](#) contains the signed QMS Representative Appointment and Authorization form.

4.2.1 Responsibilities of the QMS Representative

- a. The QMS Representative shall establish system procedures ('Elements') and ensure standard operating procedures and associated forms are in place to meet DWQMS requirements.
- b. The QMS Representative shall maintain applicable QMS documents and records and ensure their currency and accuracy by following *EP-DW-1* and *EP-DW-2*.
- c. On an annual basis, the QMS Representative shall report to Top Management on QMS performance and any need for improvement by following *EP-DW-7 Management Review*.
- d. The QMS Representative shall ensure that appropriate personnel are aware of all applicable legislative and regulatory requirements through QMS Awareness training and other communications as needed.
- e. The QMS Representative shall promote QMS awareness to department staff, including the role of the QMS Representative, through training and awareness activities as described in *Operational Plan Element 10: Competencies*.

4.3 Associated Documents

- None

5.0 Document and Records Control

[Return to Table of Contents](#)

5.1 Requirement

Element 5 of the DWQMS requires a procedure for document and record control that describes how documents and are kept current, and how documents and records are kept legible and identifiable, retrieved, stored, protected, retained and disposed of.

5.2 Document Control

The Town of Richmond Hill controls all required QMS documents through the web-based application InteleX, which

- i. maintains an accessible register of electronically controlled and uncontrolled documents;
- ii. permits read-only access;
- iii. maintains an archive of documents.

Documents are kept current through an annual review process led by the QMS Representative. All QMS personnel within the CS & EIS Departments can access and request changes to documents through the QMS Representative. The QMS Representative maintains a master hard-copy binder of QMS documents. Once printed, all QMS documents become 'uncontrolled'.

5.3 Records Control

Electronic records are stored, managed and maintained in the following applications: InteleX (quality management), WaterTrax (water quality), Maximo (water maintenance) and other software applications.

Hard-copy records are stored, managed and maintained by Public Works personnel or the Municipal Offices File Clerk using the Town's ATRIUM records management system. All record keeping is in accordance with *Chapter 290 Record – Retention – Destruction* of the *Richmond Hill Municipal Code*. Retention and disposal practices comply with applicable provincial legislation.

5.4 Associated Documents – Document Control

- EP-DW-1 *Control of Documents*
 - Attachment 1: *Approval and Release of New and Revise Documents using InteleX*
 - Attachment 2: *External Document Control*

5.5 Associated Documents – Records Control

- EP-DW-2 *Control of Records*
 - Attachment 1: *WaterTrax Security Features*
- WI-DW-4.1 *Record Keeping*

6.0 Drinking Water System Description

[Return to Table of Contents](#)

6.1 Requirement

Element 6 of the DWQMS requires a description of the Town's drinking water system, including treatment processes and distribution components, as well as a process flow chart and summary descriptions of any connected drinking water systems.

6.2 Drinking Water System Description and Flow Chart

[Appendix 'E'](#) contains the *Drinking Water System Description and Flow Chart*.

7.0 & 8.0 Risk Assessment & Risk Assessment Outcomes

7.1/8.1 Requirement

[Return to Table of Contents](#)

Element 7 of the DWQMS requires the Town to document a risk assessment process and to conduct a risk assessment accordingly. Risk assessments must be conducted every three years, and consider the reliability and redundancy of equipment. In addition, on an annual basis the currency of the information and the validity of the assumptions must be reviewed.

Elements 8 of the DWQMS requires the Town to document the outcomes of the risk assessment, including procedures for monitoring [Critical Control Limits](#), and for responding to, reporting and recording deviations from Critical Control Limits.

7.2/8.2 Risk Assessment Process

The Town of Richmond Hill manages risk to its drinking water system through proactive planning and preventative measures. The QMS Risk Assessment identifies and ranks potential hazards and events, referencing existing procedures to monitor limits and measures to prevent, mitigate, or respond to hazards. As well, it defines Critical Control Limits and [Critical Control Points](#) where required. The Risk Assessment process reveals gaps where no measures exist to address certain

risks, providing direction for future improvement. Top Management annually reviews the currency of outcomes and the validity of the process as part of Management Review.

7.3/8.3 Risk Assessment Outcomes

A Risk Assessment team conducts a risk assessment for the Town's drinking water system once every three years. Risk Assessment outcomes are recorded and communicated to Top Management through the Management Review process.

7.4/8.4 Associated Documents

- EP-DW-3 *Risk Assessment and Risk Assessment Outcomes*
 - Attachment 1: *Risk Assessment Table*
 - Attachment 2: *Risk Assessment Outcomes – High Risk Table*
- WI-DW-4.5 *Risk Assessment*

9.0 Organizational Structure, Roles, Responsibilities and Authorities

9.1 Requirement

[Return to Table of Contents](#)

Element 9 of the DWQMS requires a description of the organizational structure of the Operating Authority that includes roles, responsibilities, and authorities. Owner, Top Management, and those responsible for Management Review must also be identified.

9.2 Owner

The Town of Richmond Hill, as represented by Council, is identified as 'Owner' of the drinking water system. Council assumes Owner responsibilities and authorities outlined in the *Safe Drinking Water Act, 2002* and the DWQMS. These include:

- ensuring the Operating Authority is accredited
- endorsing and submitting the Operational Plan to the Ministry of Environment and Climate Change
- applying for the Municipal Drinking Water Licence & Drinking Water Works Permit
- developing and submitting Financial Plans to the Ministry of Municipal Affairs and Housing

9.3 Operating Authority

The Town of Richmond Hill, as represented by the Public Works Operations Division of the Community Services Department, is identified as the 'Operating Authority'¹. Public Works [Certified Operators](#) maintain and operate the drinking water system, and ensures an "Overall Responsible Operator" is available at all times to provide direction and to lead emergency response.

QMS Top Management is composed of Operating Authority administrators, and is responsible for ensuring the QMS is established and maintained. Top Management must endorse the Operational Plan before it is submitted to Council and the MOECC.

¹ Municipal Inspectors, from the EIS Department, are also included as Operating Authority personnel

[Appendix 'F'](#) contains the QMS Organizational Chart and the table of Roles, Responsibilities, Authorities, and Competencies

9.4 Associated Documents

- None

10.0 Competencies

[Return to Table of Contents](#)

10.1 Requirement

Element 10 of the DWQMS requires documentation of competencies for drinking water personnel, and of activities for developing and maintaining these competencies and for ensuring personnel are aware of the relevance of their duties. It also requires that competencies are achieved and records of the activities are maintained.

10.2 Competencies

The outcomes of this Element are identified competencies (knowledge, skills, and abilities), training needs and training activities for all Operating Authority personnel whose duties directly affect drinking water quality. The QMS Representative ensures applicable training and certification requirements, including record keeping, are met.

[Appendix 'F'](#) contains the QMS Organizational Chart and the table of Roles, Responsibilities, Authorities, and Competencies

10.3 Associated Documents

- WI-DW-4.7 *Operator Training and Certification*

11.0 Personnel Coverage

[Return to Table of Contents](#)

11.1 Requirement

Element 11 of the DWQMS requires a procedure for ensuring sufficient trained personnel are available to maintain the Town's drinking water system.

11.2 Personnel Coverage

The Public Works Division ensures that a Certified Operator is always available to operate the Town's drinking water system. Administrative staff is available on-call and to fill in for each other to ensure respective duties can be fulfilled. The department maintains a strike plan in the case of a walkout by union staff, whereby non-unionized staff and contractors assume union duties. A 'mutual assistance' agreement between Richmond Hill and neighbouring municipalities makes additional resources (equipment, staff) available in emergency situations. Element 11 is reviewed annually to ensure personnel coverage is sufficient.

11.3 Procedure

- a. The QMS Representative shall consult with the Manager of Water & Wastewater to determine how sufficient personnel coverage for drinking water operations is achieved. Personnel coverage is determined by considering:

- the roles, defined in *QMS Roles, Responsibilities and Authorities Table*, critical for maintaining the delivery of safe drinking water, including, Overall Responsible Operator, regular staff, on-call personnel, and union staff
 - normal (regular shifts with full staff) and extraordinary circumstances (emergencies, union walk-outs, staff shortage, etc.)
 - the availability of personnel to ensure key responsibilities under each role can be fulfilled in both normal and extraordinary circumstances
 - who sets the schedule
 - rationale for contacting personnel
 - response times for contacting personnel
 - SCADA or other monitoring; off-site checks
- b. In the event that personnel coverage is deemed insufficient, the Manager of Water & Wastewater is responsible for investigating and implementing options for increasing coverage to an adequate level.

[Appendix 'G'](#) contains the *QMS Personnel Coverage Table*.

11.4 Associated Documents

- None

12.0 Communications

[Return to Table of Contents](#)

12.1 Requirement

Element 12 of the DWQMS requires a procedure for communications between Top Management and Council, Operating Authority, suppliers and the public.

12.2 Procedure

The QMS Representative shall facilitate required communication between Top Management and Council, department personnel, suppliers, and the public in the following ways:

- a. Top Management and Council
 - Formal communication is achieved through preparing and submitting Staff Reports to Council on a regular and as-needed basis
 - Informal communication occurs between the Commissioner of Community Services and Council at regular Council meetings and through personal correspondence
- b. Top Management and Operating Authority personnel
 - The Drinking Water QMS Policy is posted at Town facilities, and is available electronically on the Town website and through Intelex.
 - Management and staff meet regularly through Department Meetings, and Manager/Staff, Manager/Supervisor, and Supervisor/Staff Meetings
 - Relevant QMS information is delivered through staff meetings.

- Informal communication occurs on an as-needed basis through emails, written memos, phone calls, bulletin boards, informal meetings, etc.
 - Managers and staff can communicate through Intalex in the form of non-conformance reports and opportunities for improvement, corrective and preventive actions, and document change requests.
- c. Top Management and Suppliers
- Regular meetings (pre-construction, progress, etc.)
 - Informal 'field' communications (inspectors and other Town staff)
 - Contract documents, RFQ's, tenders, information packages
 - Town of Richmond Hill QMS Contractor & Supplier Brochure
 - Town of Richmond Hill Design Standards and Specifications Manual
- d. Top Management and the Public
- The QMS Policy is accessible to the public through postings at Town facilities, and is available electronically on the Town website.
 - Drinking water information with public relevance is communicated through the local Richmond Hill newspaper (The Liberal).
 - The Town's website contains pertinent drinking water information and is regularly updated with important notices and changes.
 - The Operational Plan and Annual Water Quality Report are available to the public through the Town's website and upon request from the Community Services Dept.
 - The Public communicates with Top Management through calling the Operation Centre and/or sending an email to the following email address: drinkingwater@richmondhill.ca. Customer inquiries & complaints and their resolution are logged using the appropriate work order as detailed in WI-DW-5.3 Water Quality Inquiries and Complaints.
 - Customer inquiries and complaints are communicated to Top Management under Consumer Feedback during the Management Review.
- e. Management Review
- Communication between Department personnel and Top Management is facilitated by the QMS Representative at least once every twelve months through Management Review meetings, as detailed in EP-DW-7: *Management Review*.
- 12.3 Associated Documents
- EP-DW-7 *Management Review*
 - WI-DW-4.2 *Reports to Council*
 - WI-DW-5.3 *Water Quality Inquiries and Complaints*

13.0 Essential Supplies and Services

[Return to Table of Contents](#)

13.1 Requirement

Element 13 of the DWQMS requires identification of all essential supplies and services, and a procedure for ensuring procurement and quality of each supply or service.

13.2 Essential Supplies and Services

Those supplies and services deemed essential for the Town to deliver safe drinking water to Richmond Hill consumers are identified from a master list of supplies and services maintained by the Public Works Division. This master list includes alternate or contingent contacts (where possible) to ensure essential supplies and services can be procured whenever necessary.

Quality requirements for supplies and services are determined through provincial regulations, Town standards, and industry best practices. Quality requirements are ensured through the Town's purchasing practices, which are subject to Purchasing By-Law No.113-16.

13.3 Associated Documents

- EP-DW-4 *Essential Supplies and Services*
 - Attachment 1a: *Essential Supplies and Services Table*
 - Attachment 1b: *QMS Essential Supplies List*
 - Attachment 2: *QMS Contractor and Supplier Requirements*
 - Attachment 3: *Information for Contractor and Suppliers Brochure*
 - Attachment 4: *Letter of Acknowledgement*

14.0 Review and Provision of Infrastructure

[Return to Table of Contents](#)

14.1 Requirement

Element 14 of the DWQMS requires a procedure for the annual review of drinking water infrastructure. The outcomes of this review must be communicated to Council.

14.2 Infrastructure Review

The immediate status and adequacy of Richmond Hill's drinking water infrastructure are assessed by the Public Works Division on an ongoing basis through maintenance management data tracking. Resource requirements for maintaining adequacy are determined and communicated annually through the budget process.

Applicable sections within CS and EIS Departments annually update a Ten-Year Capital Program that establishes future infrastructure needs based on factors such as population growth, break rates, and material aging. This program is communicated to Council through the budget process.

14.3 Associated Documents

- EP-DW-5 *Infrastructure*

15.0 Infrastructure Maintenance, Rehabilitation and Renewal

15.1 Requirement

[Return to Table of Contents](#)

Element 15 of the DWQMS requires a summary of infrastructure maintenance, rehabilitation and renewal programs. The Operating Authority is required to keep this summary current, communicate it to Council, and monitor the effectiveness of its maintenance program.

15.2 Infrastructure Maintenance, Rehabilitation and Renewal Programs

The Public Works Division performs scheduled and unscheduled/emergency maintenance and rehabilitation on the Town's drinking water infrastructure. Maintenance and rehabilitation activities are planned and tracked using maintenance management software. The Design & Construction sections also participate in rehabilitation activities, depending on the nature of the project, and are responsible for infrastructure renewal and replacement under the Ten-Year Capital Program. Infrastructure maintenance, rehabilitation and renewal programs are summarized and communicated to Council through the annual QMS staff report.

15.3 Associated Documents

- EP-DW-5 *Infrastructure*
 - Attachment 1: *Infrastructure Process Flow Chart*
 - Attachment 2: *QMS Infrastructure Maintenance Rehabilitation and Renewal Summary*
 - Attachment 3: *QMS Infrastructure Maintenance, Rehabilitation and Renewal Responsibilities*

16.0 Sampling, Testing and Monitoring

[Return to Table of Contents](#)

16.1 Requirement

Element 16 of the DWQMS requires a procedure for process control that details sampling, testing and monitoring requirements and activities, and how results are communicated to Council. Relevant upstream sampling, testing and monitoring activities must also be described.

16.2 Sampling, Testing and Monitoring

The Public Works Division maintains procedures for sampling, testing, and monitoring activities required under provincial legislation and regulations. These procedures are developed for both normal and unscheduled/emergency conditions, and staff are trained accordingly. Outcomes from these activities are communicated to Council through the Annual and Summary Reports as required by O. Reg. 170/03. Upstream sampling, testing and monitoring activities are performed by the City of Toronto and the Regional Municipalities of Peel and York. Details and outcomes of these activities are available through respective annual/summary reports.

16.3 Associated Documents

- WI-DW-3.1 *Water Samples*
- WI-DW-3.2 *Residual Chlorine Monitoring*
- WI-DW-3.4 *Adverse Water Quality Reporting*

- WI-DW-4.2 *Staff Reports to Council*
- WI-DW-5.3 *Water Quality Inquiries and Complaints*

17.0 Equipment Calibration and Maintenance

[Return to Table of Contents](#)

17.1 Requirement

Element 17 of the DWQMS requires a procedure for the calibration and maintenance of measurement and recording equipment.

17.2 Equipment Calibration and Maintenance

Applicable standard operating procedures contain instructions for calibration and maintenance of measurement and recording equipment. Calibration and maintenance is performed either in house or by the manufacturer or contractor, in accordance with relevant legislative requirements and/or manufacturers' specifications.

17.3 Associated Documents

- WI-DW-2.6 *Equipment Calibration and Maintenance*
- WI-DW-3.2 *Residual Chlorine Monitoring*

18.0 Emergency Management

[Return to Table of Contents](#)

18.1 Requirement

Element 18 of the DWQMS requires a procedure for maintaining a state of emergency preparedness that identifies potential emergencies and covers response and recovery, training and testing, responsibilities, and communications.

18.2 Emergency Management

The Town of Richmond Hill, through its QMS Risk Assessment identifies and documents potential emergency situations that might ultimately impact drinking water safety. Preventive, response and recovery measures are identified for each type of emergency, and described in applicable procedures.

Response and recovery measures are initiated when adverse water conditions are detected. Internal procedures contain communications protocols, departmental and corporate roles and responsibilities, contact lists, and where appropriate references to the Corporate *Emergency Plan*. An inter-municipal communications procedure contains instructions for reporting adverse conditions between connected drinking water systems.

Staff are trained to deal with emergencies and to follow applicable procedures in accordance with provincial and municipal regulations. Where possible, emergency procedures are tested and emergency equipment inspected and maintained.

18.3 Associated Documents

- EP-DW-6 *Emergency Management*

19.0 Internal Audits

[Return to Table of Contents](#)

19.1 Requirement

Element 19 of the DWQMS requires a procedure for internal audits to evaluate QMS conformity with the standard. Audits must be conducted every twelve months.

19.2 Internal Audits

On an annual basis, the QMS Representative establishes an Internal Audit program that evaluates conformity with the requirements of the provincial Drinking Water Quality Management Standard. This program is set up in accordance with QMS procedures that outline how the audit should be conducted, who will perform the audit, when it will occur, and how the outcomes will be recorded and communicated. Typically, an Audit Team consisting of trained auditors develops checklists used in interviews with a sampling of QMS personnel, from Commissioner to Operator. Non-conformities and opportunities for improvement are identified through the interview process and are entered in the web-based Intelex application, through which corrective actions are generated, assigned and tracked. Internal Audit outcomes are summarized and communicated to QMS applicable Section Managers and Top Management.

19.3 Associated Documents

- WI-DW-4.4 *Internal Audits*

20.0 Management Review

[Return to Table of Contents](#)

20.1 Requirement

Element 20 of the DWQMS requires a procedure for management review that evaluates the continuing suitability, adequacy and effectiveness of the QMS.

20.2 Management Review

QMS Top Management is required to evaluate the suitability, adequacy and effectiveness of the QMS on an annual basis. This evaluation occurs through the Management Review process:

- The QMS Representative collects QMS information, such as Internal Audit and Risk Assessment outcomes, and distributes it to Top Management for review
- At a meeting or series of meetings, Top Management provide feedback, direction, and recommendations to the QMS Representative regarding system status and improvement
- Recommendations are recorded and entered into Intelex, where they are assigned, tracked and stored for future reference

Outcomes of the annual Management Review are communicated to Council in the annual QMS staff report.

20.3 Associated Documents

- EP-DW-7 *Management Review*

21.0 Continual Improvement

[Return to Table of Contents](#)

21.1 Requirement

Element 21 of the DWQMS requires the Operating Authority to strive to continually improve the effectiveness of its QMS through the use of corrective actions.

21.2 Continual Improvement

The Town of Richmond Hill is committed to continually improving its drinking water QMS. Several methods of improvement are embedded in and essential to the system:

- Management Review
- Internal Audits & External Audits
- Document Review
- Document Change Requests
- Non-conformity Reports (NCR) and Opportunities for Improvement (OFI)

Corrective actions are generated through audits and management reviews, and on an ongoing basis through NCR/OFI submissions. The department's web-based Intelex application stores, communicates, and tracks progress on corrective actions.

21.3 Associated Documents

- EP-DW-8 *Continual Improvement*
 - Attachment 1: *QMS Continual Improvement Process – Flow Chart*

DEFINITIONS

[Return to Table of Contents](#)

“Adverse Water Quality” – occurs when testing of water samples reveals a breach of Ontario’s prescribed drinking water quality standards, indicating the potential presence of a drinking water health hazard in the water.

“Certified Operator” – an individual who has been certified by the province, based on a combination of relevant and ongoing education and experience, to perform operational duties on a drinking water system. Certification is renewed every three years.

“Critical Control Limit” – a determined threshold for a *critical control point* that, if exceeded, triggers initiation of an appropriate response procedure

“Critical Control Point” – an essential step or point in the drinking water system at which control can be applied to prevent or eliminate a drinking water health hazard, or reduce it to an acceptable level (from DWQMS Terms and Definitions)

“DWQMS” – the Drinking Water Quality Management Standard, or *DWQMS*, is a provincially-developed management standard based on ISO 9001 and HACCP standards. It was created in response to the Walkerton Report’s recommendations for quality management in municipal drinking water systems, and was first released in 2006.

“Quality Management” – in the context of drinking water, is to protect public health by achieving consistent good practice in managing and operating a water system (Walkerton Report, Part II)

“Quality Management System” (QMS) – a system to:

- a. establish policy and objectives, and to achieve those objectives; and
- b. direct and control an organization with regard to quality (from DWQMS Terms and Definitions)

HISTORY OF CHANGES

[Return to Table of Contents](#)

Version Number	Release Date	Details of Changes
1.0	10/20/2008	Original version.
1.1	11/20/2008	<ul style="list-style-type: none"> Element 18 - Emergency Management now specific to QMS Minor wording and format changes Schedule 'C' added
1.2	07/01/2010	Minor updates stemming from Annual Review of document.
2.0	04/20/2011	<ul style="list-style-type: none"> Updates from Annual Review and departmental re-organization Printed documents considered 'uncontrolled' Internal Audit outcomes no longer required to be communicated to Council
2.1	Not released	<ul style="list-style-type: none"> Added 'Definitions' and 'History of Changes' sections Changed 'Senior Management' to 'Top Management' 5.2 – multiple hard copy QMS binders no longer maintained 9.3 – Added information about 'Overall Responsible Operator' Other minor wording and formatting changes
3.0	09/06/2013	<ul style="list-style-type: none"> Elements 1-4, 6, 9-12: Element Procedures eliminated, and where possible relevant information and/or Element Outcome incorporated into Plan Element 1 – added reference to approval process for new watermains Modified description of and references to QMS documentation Combined Elements 7 & 8 in OP Created new Element Procedure for Element 21 Continual Improvement Added signed Top Management endorsement
3.1	12/02/2013	<ul style="list-style-type: none"> Added Release Date for v. 3.0 Updated Contact Information in Schedule "C"
3.2	02/05/2014	<ul style="list-style-type: none"> Added March 24, 2014 Council Endorsement to Appendix 'C' Updated QMS Organizational Chart in Appendix 'F'
4.0	03/05/2015	<ul style="list-style-type: none"> Updated QMS Representative in Appendix 'D' Updated QMS Organizational Chart in Appendix 'F' Other minor wording and formatting changes
4.1	04/20/2015	<ul style="list-style-type: none"> Updated name of Acting Manager of Water & Wastewater with current Manager of Water & Wastewater information. Inserted Council Endorsement in Appendix 'C'
4.2	02/29/2016	<ul style="list-style-type: none"> Associated Documents have been properly cited for each Element of the Standard. Added to Element 12, in section 12.2.d clarification as to how the Public communicates with Top Management. TRH(water drop)DWQMS symbol has been updated to RH(tap)WATER for it promotes the quality of the water instead of the quality management system. Organizational Chart and Table of Roles and Responsibilities has been updated to include Project Managers for Capital Infrastructure
4.3	02/28/2017	<ul style="list-style-type: none"> Updated Design and Construction Division in Element 1 as Project Managers-Capital Infrastructure are part of 'Appendix F' Element 7 & 8 updated to include annual review of the currency of the

		<p>information and the validity of the assumptions.</p> <ul style="list-style-type: none">• Corrected associated documents within all Elements as Standard Operating Procedures have changed.• Other minor wording and formatting changes.• New Endorsement Form 'Appendix B' has to be update to include: current Operational Plan Version/Release Date and Endorsement Date.
--	--	--

QMS Operational Plan

APPENDICES

[Return to Table of Contents](#)



Town of Richmond Hill

Drinking Water Quality Management System Policy

The Town of Richmond Hill is committed to providing a safe, consistent supply of drinking water to the community.

To help ensure the drinking water distribution system and the drinking water itself are of the highest quality possible, the Town has implemented and will maintain a Quality Management System (QMS). As well, the Town will strive to continually improve the QMS through regular review, evaluation, and action.

The Town commits to complying with all applicable legislation and regulations in pursuit of high quality water and efficient distribution.

These commitments support the Town's Strategic Plan goals:

- Wise Management of Resources
- Stronger Connections
- Better Choice
- A More Vibrant Richmond Hill



RichmondHill.ca/Water

Town of Richmond Hill Drinking Water Quality Management System	QMS Elements	Prepared by: QMS Representative Approved by: QMS Top Management	
Document Title: QMS Policy	Page: 1 of 1	Revision #: 4	Date: February 25, 2016

Appendix 'B': Top Management Signed Commitment and Endorsement Form

[Return to Table of Contents](#)

QMS Top Management, through signing this document, expresses its endorsement of this Operational Plan and its commitment to fulfilling the respective roles and responsibilities outlined therein.

Specifically, Top Management commits, to the best of its ability and subject to budget approval, to providing resources and support for satisfying or exceeding the requirements of Ontario's Drinking Water Quality Management Standard, and for maintaining and continually improving the Town's Drinking Water Quality Management System.

Commissioner of Community Services

Department



Shane Baker

Director of Public Works Operations



Grant Taylor

Manager of Water & Wastewater



Diogo Oliveira

Manager of Construction



Doug Morris

Manager of Design



Lucius Maitre

QMS Program Coordinator



Zully Robles

Version 4.3 02/28/17

Operational Plan Version / Release Date

Feb / 16 / 2018

Endorsement Date

Appendix 'C': Council Endorsement (to be inserted once approved)

[Return to Table of Contents](#)

**Extract from
Committee of the Whole Meeting
CW#04-17 held March 21, 2017**

8. Municipal Drinking Water System Reporting – (Staff Report SRCS.17.06)

Recommendation 4

- a) That the Summary Report of Richmond Hill's drinking water system, as set out in staff report SRCS.17.06 and as required under Schedule 22 of O. Reg. 170/03, be received;**
- b) That the Town of Richmond Hill 2016 Annual Report regulatory reporting for municipal drinking water systems, attached as Appendix '1' to staff report SRCS.17.06 and as required under Section 11 of O. Reg. 170/03, be received;**
- c) That the Ministry of the Environment and Climate Change 2016 Inspection Report for Richmond Hill's drinking water system, attached as Appendix '2' to staff report SRCS.17.06, be received;**
- d) That updates and information regarding the Quality Management System 2016 Annual Report, attached as Appendix '3' to staff report SRCS.17.06, be received;**
- e) That Richmond Hill's Quality Management System "Operational Plan", version 4.3, attached as Appendix '4' to staff report SRCS.17.06, be endorsed by Council.**



Richmond Hill Drinking Water

Appendix 'D': QMS Representative Authorization and Appointment

[Return to Table of Contents](#)

Appendix 'E' – Element 6 Drinking Water Description and Flow Chart

[Return to Table of Contents](#)

1.1 Drinking Water System Description

DW System	Owner/Operator	System Description
<p>Town of Richmond Hill</p> <ul style="list-style-type: none"> Supplies drinking water to residential and business consumers 	<p><i>Owner:</i></p> <ul style="list-style-type: none"> The Corporation of The Town of Richmond Hill <p><i>Operating Authority:</i></p> <ul style="list-style-type: none"> Town of Richmond Hill, Public Works Operations Division 	<p>Richmond Hill owns and operates a Class 2 Water Distribution System</p> <ul style="list-style-type: none"> Approximately 606 km of watermains located typically on local roads Watermain sizes: 50-500 mm in diameter Materials are predominately PVC, cast iron and ductile iron, but also include: Asbestos Cement, Concrete, Copper, Concrete Pressure Pipe, and HDPE Average age of watermains = 20 years <p>This distribution system does not include water storage, chlorine boosting, pressure boosting, or secondary disinfection.</p>
<p>Region of York</p> <ul style="list-style-type: none"> Supplies potable water wholesale to Richmond Hill 	<p><i>Owner:</i></p> <ul style="list-style-type: none"> The Regional Municipality of York <p><i>Operating Authority:</i></p> <ul style="list-style-type: none"> The Regional Municipality of York – Environmental Services Department 	<p>York Region obtains treated and tested water from the City of Toronto and Peel Region</p> <ul style="list-style-type: none"> The infrastructure of the York Water Distribution System is responsible for the continuous supply of potable water to area municipalities (Aurora, Markham, Newmarket, Richmond Hill and Vaughan) The York Water Distribution System consists of 8 pumping stations, 5 elevated tanks, 7 reservoirs, 14 metering chambers, and 7 valve chambers Large diameter watermains transmit water between pumping stations and storage facilities
<p>City of Toronto</p> <ul style="list-style-type: none"> Draws raw water from Lake Ontario and supplies potable water to the City of Toronto and parts of York Region 	<p><i>Owner:</i></p> <ul style="list-style-type: none"> City of Toronto <p><i>Operating Authority:</i></p> <ul style="list-style-type: none"> City of Toronto 	<p>The City of Toronto Drinking Water System is owned by the City of Toronto and operated by the City's Toronto Water Division. The system consists of:</p> <ul style="list-style-type: none"> 7 water treatment plants 18 pumping stations 10 major underground storage reservoirs 4 elevated storage tanks <p>The system supplies drinking water to the City of Toronto and parts of York Region. The York Water System is owned and operated by the Regional Municipality of York.</p>
<p>Region of Peel</p> <ul style="list-style-type: none"> Draws and treats raw water from Lake Ontario and supplies potable water wholesale to York Region 	<p><i>Owner:</i></p> <ul style="list-style-type: none"> Regional Municipality of Peel <p><i>Operating Authority:</i></p> <ul style="list-style-type: none"> Ontario Clean Water Agency (treatment) Region of Peel (distribution) 	<p>Ontario Clean Water Agency, on behalf of Peel Region, operates and maintains:</p> <ul style="list-style-type: none"> two water treatment facilities (Lakeview Water Treatment Plant and Lorne Park Water Treatment Plant) 11 pumping stations (10 with reservoirs) 3 elevated tanks <p>Region of Peel operates and maintains the South Peel distribution system:</p> <ul style="list-style-type: none"> 3 pumping stations 2 standpipes 1 elevated tank <p>Water is pumped from Lakeview Treatment Plant to Airport P.S. and reservoir via the South Peel transmission system, chloraminated using sodium hypochlorite and ammonia and pumped to York Region Maple Reservoir.</p>

1.2 Raw Water Characterisation

Richmond Hill's drinking water originates in Lake Ontario, where it is treated by the City of Toronto and Region of Peel.

a. City of Toronto – Raw Water Characterisation

The following is excerpted from the City of Toronto's QMS Operational Plan, revision date March 15, 2012.

Description of the Water Source and Protection Initiatives

Lake Ontario is the raw water source for Toronto's drinking water. Lake Ontario's turbidity is generally low, alkalinity is low to moderate, pH experiences limited seasonal fluctuation (peak values may reach the upper range in the summer months), and colour is low. Raw water temperatures vary seasonally. Water temperatures can exceed 20 degrees Celsius in summer and approach zero degrees Celsius in winter. The water is considered moderately hard.

Common event-driven fluctuations, operational challenges and threats may include:

- seasonal temperature changes which can impact settling and disinfection
- vertical lake turnover in spring and fall which can increase raw water turbidity
- algal blooms which can cause taste and odour issues, and
- zebra mussel or debris which have the potential to block intakes

Additionally, Lake Ontario is impacted by basin-wide pollution inputs and local, nearshore water quality. The City of Toronto (the City) has taken an active role in protecting water quality within its boundaries and improving water quality within the lake through the Wet Weather Flow Master Plan (the Plan). The Plan is expected to be the foundation of the City's contribution toward the Source Water Protection Plan being developed through the Toronto and Region Conservation Authority, in accordance with the requirements of Ontario's Clean Water Act. The Plan is a long-term plan to protect our environment and sustain healthy rivers, streams and other water bodies. The 25-Year Plan outlines programs and projects that, together, provide a solution for stormwater pollution.

b. Region of Peel – Raw Water Characterization

The following is excerpted from the Region of Peel's QMS Procedure: South Peel Drinking Water Distribution System, Rev. 3, dated January 14, 2013.

Source Water

Lake Ontario is the sole source of raw water for the Lakeview and Lorne Park WTPs. The raw water from Lake Ontario is typically low in turbidity. The temperature fluctuates significantly through the seasons. Bacteriological analysis of the raw water indicates a source of relatively good quality. The results of chemical analyses consistently meet the Ontario Drinking Water Quality Standards. For general characteristics of the raw water supply refer to [Water Quality Report](#).

Table 1: Physical Characteristics of Lake Ontario (as supplied by OCWA)

Item	Imperial Units	Metric Units
Length	193 miles	311 km
Breadth	53 miles	85 km
Average Depth	283 ft	86 m
Maximum Depth	802 ft	244 m
Volume	393 cu. miles	1,640 km ³
Surface Area	7,340 sq. miles	18,960 km ²
Land Drainage	24,720 sq. miles	64,030 km ²
Shoreline Length	712 miles	1146 km
High Water Level and Low Water Level*	244 to 247 ft	74.3 to 74.990 m

* Source: National Oceanic and Atmospheric Administration (NOAA): Great Lakes Environmental Research Library (GLERL) <http://www.glerl.noaa.gov/pubs/brochures/lakelevels/lakelevels.pdf>.

Common Fluctuations

- Refer to OCWA's Operational Plan
- Temperature in the Distribution System

Threats

- Contamination resulting from illegal connections/water theft and failure of: upstream treatment processes, storage facilities, pipe failure, backflow or cross-connections
- Loss of water supply or pressure due to failure of: pumps, pipes, appurtenances or control instrumentation
- Damage to pipes or appurtenances due to high (excessive) pressure, corrosion, construction activity, etc.


Operational Challenges

- Optimizing pressure throughout pressure zones
- Controlling pressure transients and surges
- Preventing failure of pumps, SCADA and control instrumentation
- Mitigating a prolonged power outage
- Minimizing third-party damage to system components
- Ensuring fire hydrant function
- Maintaining an adequate & qualified labour force
- Minimizing water odour & taste problems

1.3 TRH Common Event Driven Fluctuations and Resulting Operational Challenges


- algae blooms in Lake Ontario can affect the taste and odour of the water that eventually enters Richmond Hill's distribution system
 - customer complaints regarding taste and odour may rise
- warm weather can decrease the duration, and therefore effectiveness, of residual chlorine in the distribution system
 - increased flushing may be necessary to introduce new water and mitigate the risk of low residuals

1.4 Drinking Water System – Process Flow Chart

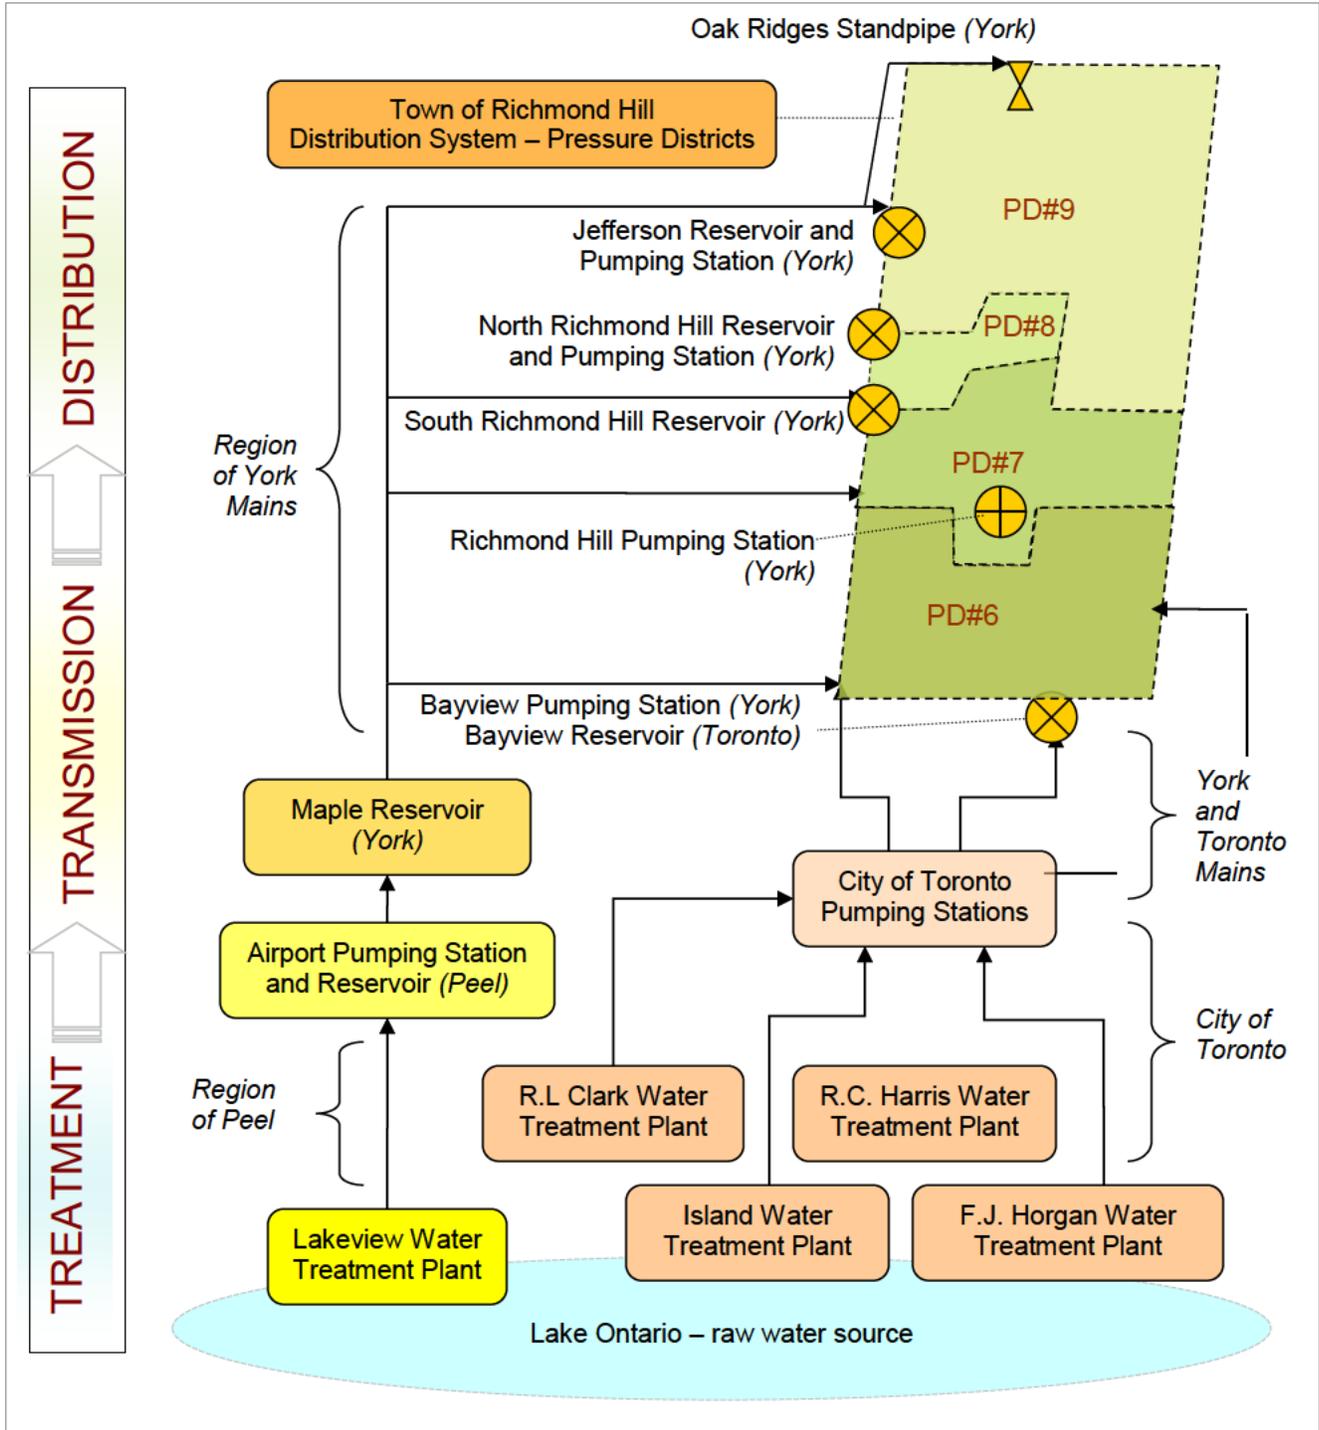

Appendix 'F' – Element 9 & 10 Organizational Chart and Table of Roles, Responsibilities, Authorities and Competencies [Return to Table of Contents](#)

1.1 QMS Organizational Chart

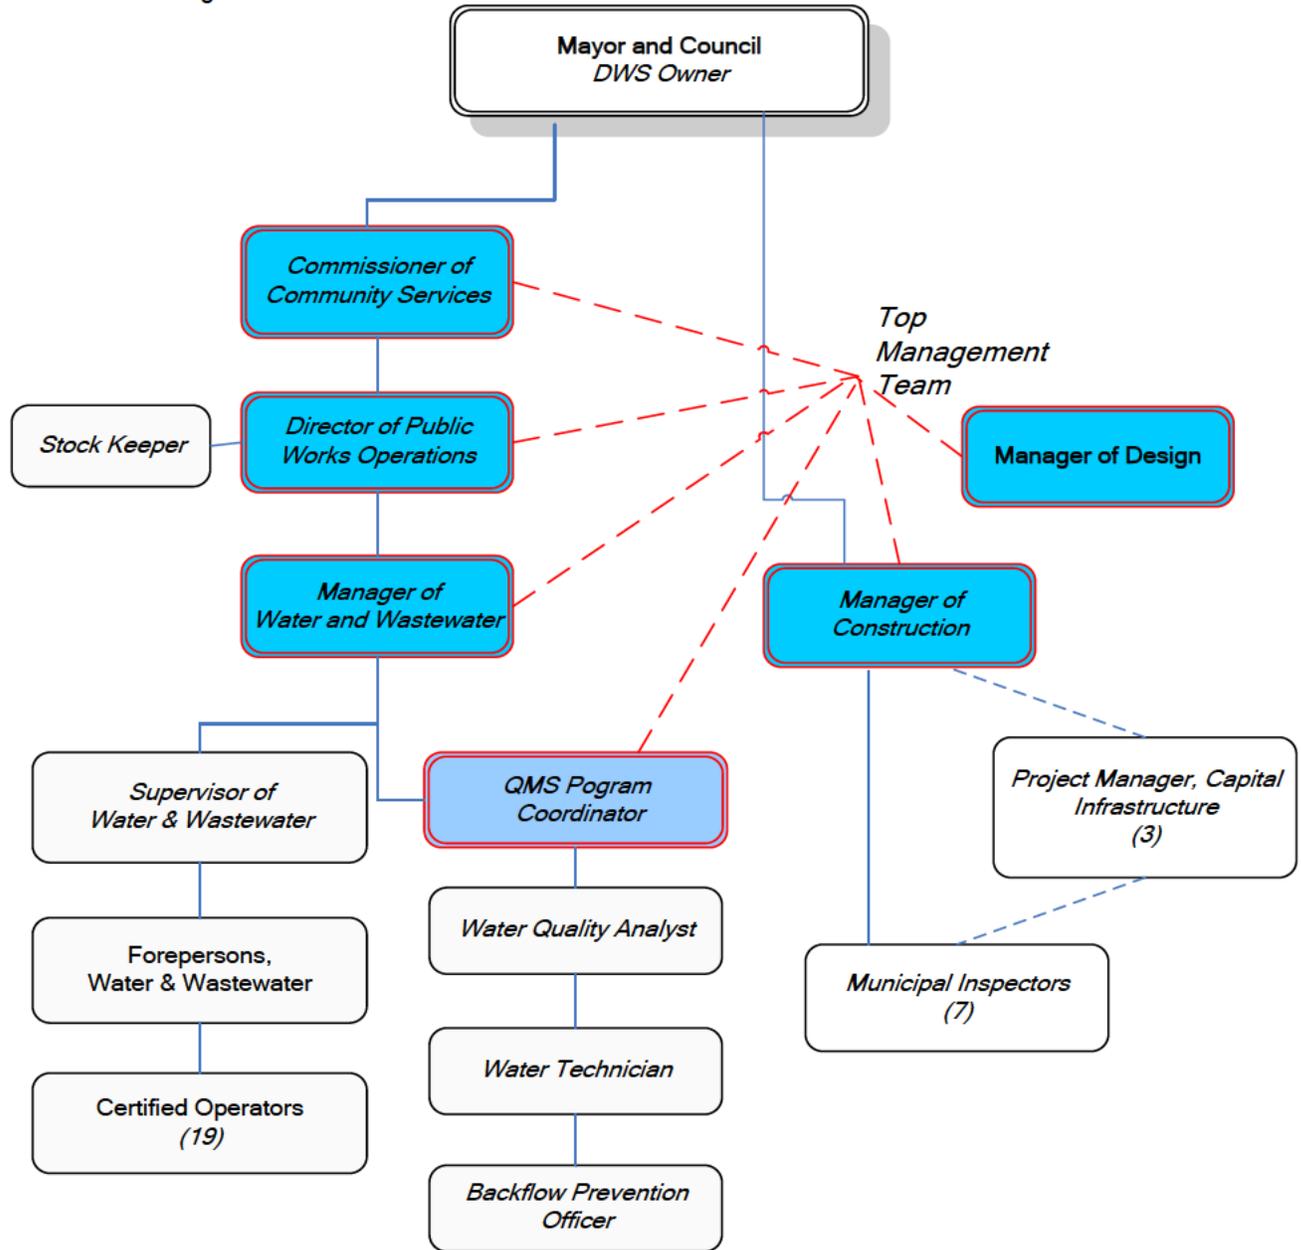

1.2 Table of Roles, Responsibilities, Authorities and Competencies

A. DRINKING WATER SYSTEM ADMINISTRATION AND OVERSIGHT

1. Owner: The Corporation of the Town of Richmond Hill, as represented by Council

RESPONSIBILITIES	AUTHORITIES
<ul style="list-style-type: none"> • Ensure accreditation of Operating Authority • Endorse and submit Operational Plan • Submit application for DWWP and Municipal Drinking Water Licence • Develop Financial Plan and submit to Ministry of Municipal Affairs and Housing 	<ul style="list-style-type: none"> • To establish and alter drinking water system • To approve QMS and Operational Plan • Financial and administrative authority related to distribution of safe drinking water • Approve by-laws and taxation rates

2. Operating Authority: Town of Richmond Hill, Public Works Operations Division of the Community Services Department

RESPONSIBILITIES	AUTHORITIES
<ul style="list-style-type: none"> • Develop Operational Plan and implement QMS • Submit Operational Plan and application to accreditation body for audit • Ensure Owner endorses Operational Plan • Provide and/or obtain resources required for QMS and for ensuring safe supply of drinking water 	<ul style="list-style-type: none"> • To operate a drinking water system • Technical authority related to distribution of safe drinking water • Set user fees

3. QMS Top Management: Community Services Commissioner; Director of Public Works Operations; Manager of Construction; Manager of Water & Wastewater

RESPONSIBILITIES	AUTHORITIES
<ul style="list-style-type: none"> • Endorse Operational Plan • Ensure QMS is in place and conforms to standard • Ensure applicable staff are aware of legislative and regulatory requirements • Communicate QMS to Owner, applicable staff and personnel, suppliers, and public • Determine, obtain or provide resources for maintaining and improving the QMS • Appoint a QMS Representative • Conduct regular Management Reviews of QMS • Communicate results of reviews to Owner 	<ul style="list-style-type: none"> • Authorize a QMS Representative • Budget requests for QMS maintenance and improvement • Authorize Policy and Operational Plan • Hire, discipline or terminate department staff

4. Commissioner of Community Services Department

RESPONSIBILITIES	
<ul style="list-style-type: none"> • Liaise between department, CAO, and Council • Participate in Top Management activities • Approve and sign QMS Policy 	<ul style="list-style-type: none"> • Ensure Community Services Department complies with all drinking water legislation • Determine, obtain or provide resources for maintaining and improving the QMS
AUTHORITIES	
<ul style="list-style-type: none"> • Recommends staff reports to Council 	<ul style="list-style-type: none"> • Authorize budgetary requests for department
REQUIRED COMPETENCIES	
<p>QMS:</p> <ul style="list-style-type: none"> • QMS Awareness • EMS Awareness • WHMIS 	<p>General:</p> <ul style="list-style-type: none"> • Knowledge of water distribution system, capital planning and development processes • Knowledge and awareness of risks affecting water quality and Town population • Emergency management and response
DESIRED COMPETENCIES	
<ul style="list-style-type: none"> • Diversified professional experience • Demonstrated leadership skills • Excellent communicator and team builder with highly developed technical, negotiation and problem-solving skills • Ability to respond effectively to complex, sensitive issues • Additional education in Public or Business Administration • Strong public service orientation and awareness of current political/economic priorities affecting municipal government 	

5. Director of Public Works Operations

RESPONSIBILITIES	
<ul style="list-style-type: none"> Participate in Top Management activities Determine, obtain or provide resources for maintaining and improving the QMS 	
AUTHORITIES	
<ul style="list-style-type: none"> Authorize budget requests for Maintenance & Operations division Hire, discipline or terminate staff 	
REQUIRED COMPETENCIES	
QMS: <ul style="list-style-type: none"> QMS Awareness EMS Awareness WHMIS 	General: <ul style="list-style-type: none"> University degree in Engineering or suitable equivalent Minimum eight (8) years experience including related management experience within unionized environment Thorough knowledge of maintenance and design standards, materials and construction methods as they apply to the municipal environment
DESIRED COMPETENCIES	
<ul style="list-style-type: none"> P. Eng. designation or eligibility for licensing as a Professional Engineer by Professional Engineers Ontario (PEO) Strong leadership skills, proven abilities to motivate and manage people at all levels Excellent communication and negotiation skills Strong problem-solving abilities 	

6. Manager of Water & Wastewater

RESPONSIBILITIES	
<ul style="list-style-type: none"> Facilitate QMS processes as part of Implementation/Risk Assessment Team Staff hiring, training and evaluation Approve payments for goods and services 	<ul style="list-style-type: none"> Communicate with connected water systems (City of Toronto, Region of York) Prepare, review and approve SOP's, forms; review and approve other QMS documents/records Acting ORO as necessary
AUTHORITIES	
<ul style="list-style-type: none"> Delegate ORO Staffing for unionized and non-unionized positions in water section 	<ul style="list-style-type: none"> Identify and oversee staff training needs Approve SOP's Review/approve key QMS documents
REQUIRED COMPETENCIES	
QMS: <ul style="list-style-type: none"> QMS Awareness EMS Awareness Confined Space Entry Elements CPR/AED Training First Aid Certification Spill Response Training Media Training WHMIS 	General: <ul style="list-style-type: none"> College Diploma in Civil Engineering Technology or related discipline Ministry of Environment and Climate Change Certificate of Competency in Water Distribution Class 2 and Wastewater Collection Class 2 7-10 years experience in water distribution and wastewater collection system maintenance and management within a unionized environment Thorough knowledge of Safe Drinking Water Act; maintenance and design standards, materials, and construction methods; applicable laws and legislation Experience in operating a maintenance management system for water and wastewater services
DESIRED COMPETENCIES	
<ul style="list-style-type: none"> Registration with PEO or OACETT Strong leadership and interpersonal skills Excellent project management, organizational, time management skills and ability to work under pressure Strong team player, strong customer service skills, excellent written, oral, presentation and problem solving skills 	

7. QMS Program Coordinator

RESPONSIBILITIES	
<ul style="list-style-type: none"> • Fulfill duties of QMS Representative as required by DWQMS • Facilitate QMS implementation as part of Implementation Team • Administer the Quality Management System by ensuring that applicable processes and procedures are established and maintained; • Report QMS performance and need for improvement to Top Management; • Ensure the use of most current versions of QMS documents; • develop procedures for the performance of the internal audits of the system, and conduct or facilitate those audits, as well as assist external auditors 	<ul style="list-style-type: none"> • Ensure personnel are aware of applicable legislative and regulatory requirements; • Promote awareness of QMS throughout the Department • Facilitate training needs for certified staff • Monitoring and managing certification process • Managing training records • Regulatory reporting
AUTHORITIES	
<ul style="list-style-type: none"> • Lead Management Review process & Internal Audits • Establish, implement and maintain QMS policies/procedures 	<ul style="list-style-type: none"> • Review and revise Operational Plan • Develop/lead QMS Awareness Training
REQUIRED COMPETENCIES	
<p>QMS:</p> <ul style="list-style-type: none"> • QMS Awareness & EMS Awareness • Strong working knowledge of Quality Management Systems and standards • Completion of an Internal Auditors course • Familiarity with the ISO 14001 Standard for Environmental Management Systems 	<p>General:</p> <ul style="list-style-type: none"> • Completion of a College or University program in Environmental Studies, Science or Engineering • Ability to work independently with little supervision, and collaboratively in a team • Possess superior communication, organizational and project management skills • Capability to deal effectively with public; meet deadlines • Excellent written and keyboarding skills including knowledge in word processing and spreadsheets are essential to the position
DESIRED COMPETENCIES	
<ul style="list-style-type: none"> • Knowledge of risk assessment • Experience working in the Municipal Engineering Sector would be an asset 	

B. DRINKING WATER OPERATIONS

8. Supervisor, Water & Wastewater

RESPONSIBILITIES	
<ul style="list-style-type: none"> • Facilitate QMS processes as part of Implementation/Risk Assessment Team • Communicate with connected water systems (City of Toronto, Region of York) • Supervise operations staff and provide technical direction for drinking water activities 	<ul style="list-style-type: none"> • Prepare and review standard operating procedures, forms • Identify training needs for certified staff • Manage drinking water documents and records related to operations • Overall Responsible Operator (ORO) unless absent (delegated to Director/Manager/Supervisor/Foreperson, as applicable and available) • Emergency incident reporting (AWQI, spill reports)
AUTHORITIES	
<ul style="list-style-type: none"> • ORO • Staff scheduling and supervision 	<ul style="list-style-type: none"> • Supervision of maintenance contractors • Ordering of materials and resources as necessary
REQUIRED COMPETENCIES	
<p>QMS:</p> <ul style="list-style-type: none"> • QMS Awareness & EMS Awareness • Confined Space Entry Program Elements • Construction Safety • Continuing Education Training – W&WW 	<p>General:</p> <ul style="list-style-type: none"> • Post secondary diploma in Civil Engineering Technology • Registration at the technologist level with OACETT • 5 to 7 years progressive experience in a water/wastewater maintenance and operation capacity

<ul style="list-style-type: none"> CPR/AED Training Electrical Safety Awareness First Aid Certification Media Training Spill Response Training TJ Mahoney Road School – Const. & Maint. Traffic Control Safety Trench Safety WHMIS 	<ul style="list-style-type: none"> Experience with training in water distribution and wastewater collection maintenance Supervisory experience in a unionized environment Practical working knowledge in: municipal water distribution and wastewater collection infrastructure operations and maintenance, associated materials and supplies, applicable health and safety legislation, MTO traffic control regulations and maintenance procedures Ministry of the Environment Certificate of Competency in Water Distribution Subsystem Class 2 and Waste Water Collection Class 2
DESIRED COMPETENCIES	
<ul style="list-style-type: none"> accomplished team player excellent communication, organizational, writing and customer service skills 	

9. Water & Wastewater Foreperson

RESPONSIBILITIES	
<ul style="list-style-type: none"> Plan, assign, organize, assist where necessary work crews and equipment in daily maintenance & repair of storm sewer systems, water distribution systems, sanitary sewer systems Receive and investigate emergency and other calls regarding to sewer and water systems and carry out authorized remedial action On-the-job training of Works staff Maintain up-to-date records of work performed 	<ul style="list-style-type: none"> Maintain daily work records of sewer and water crews, including contractors planning of daily work schedules and scheduling of staff and contractors Coordinate with other departments for new construction, system expansion, system controls and system planning as required Communicate on a regular basis with supervisory staff and residents on any related water and sewer matter, both verbally and written Ensure the Town's water distribution system is operated in compliance with Ontario's <i>Safe Drinking Water Act</i> & Regulations Emergency incident reporting (AWQI, spill reports)
AUTHORITIES	
<ul style="list-style-type: none"> assign and schedule work crews for daily routine and emergency maintenance 	
REQUIRED COMPETENCIES	
<p>QMS:</p> <ul style="list-style-type: none"> QMS Awareness & EMS Awareness Construction Safety Continuing Education Training – W&WW Operators CPR/AED Training Electrical Safety Awareness First Aid Certification Media Training Spill Response Training TJ Mahoney Road School – Const./Maint. Traffic Control Safety Trench Safety Propane Handling Confined Space Entry Program Elements Heavy Equipment Operator Safety WHMIS 	<p>General:</p> <ul style="list-style-type: none"> Minimum 5 years experience in all elements of Water and Wastewater maintenance and operations Secondary School Graduation Diploma, or equivalent Experience in a supervisory capacity with demonstrated skills in assigning work to staff and being aware of conditions that affect employee safety Working knowledge of the Occupational Health and Safety Act Must possess in good standing a minimum certification at a Class 2 Level in Waste Water Collection and a Class 2 Level in Water Distribution Experience in reading and interpreting engineering drawings and site plans A valid Ontario Class "D" driver's license with air brake endorsement in good standing Working knowledge of computer programs.
DESIRED COMPETENCIES	
<ul style="list-style-type: none"> Excellent oral and written communication skills Excellent customer service skills Ability to compile various reports 	

10. Lead Hand *(all responsibilities/authorities/competencies same as Water Foreperson, plus:)*

RESPONSIBILITIES
<ul style="list-style-type: none"> Lead Hand is responsible for leading work crews in the field, and acts as the liaison between Foreperson and Operators Assumes Foreperson responsibilities when no Foreperson is on duty

11. Certified Operator

RESPONSIBILITIES	
<ul style="list-style-type: none"> • Perform daily maintenance & repair of water distribution systems • Water sampling; repairs to watermain breaks and meters; and confined space entry • Receive and investigate emergency and other calls regarding to sewer and water systems and carry out authorized remedial action • Maintain up-to-date records of individual, small work crew, or contractor work performed • Coordinate with other departments for new construction, system expansion, system controls and system planning as required • Communicate on a regular basis with forepersons, supervisory staff and residents on water and sewer issues, both verbally and written • Ensure the Town's water distribution system is operated in compliance with the Ontario's <i>Safe Drinking Water Act</i> and Regulations • Emergency incident reporting (AWQI, spill reports) 	
AUTHORITIES	
<ul style="list-style-type: none"> • Supervise routine and emergency maintenance by individuals and small work crews 	
REQUIRED COMPETENCIES	
<p>QMS:</p> <ul style="list-style-type: none"> • QMS Awareness & EMS Awareness • Confined Space Entry Program Elements • Construction Safety • CPR/AED Training • First Aid Certification • Spill Response Training • TJ Mahoney Road School – Const./Maint. • Traffic Control Safety • Trench Safety • WHMIS • Propane Handling • Heavy Equipment Operator Safety • Electrical Safety Awareness • Continuing Education Training – W&WW 	<p>General:</p> <ul style="list-style-type: none"> • High school diploma or equivalent • Minimum Operator in Training status in Water Distribution and Wastewater Collection • Completed WCWC "Entry Level Drinking Water Operators Course" if Level 1 Cert. in Water Distribution & Wastewater Collection has not been achieved • Achieve Ontario MOECC certification of Water Distribution Subsystem Class 2 and Wastewater Collection Class 2 within 4 years from date of hire into this position • Ontario Class DZ driver license in good standing and must provide a current Ontario drivers abstract from the M.T.O. • Construction/ maintenance of roadways, curbs, sidewalks, water distribution and wastewater collection systems • Experience and knowledge of equipment for the sanding & plowing of roads & sidewalks • Prepare, keep records; read/interpret engineering drawings • General knowledge of Occupational Health and Safety Act • Physically and medically able and competent to perform the physical demands of this position under adverse weather and site conditions, including confined space entry

12. Water Quality Analyst

RESPONSIBILITIES	
<ul style="list-style-type: none"> • Facilitate QMS processes as part of Implementation/Risk Assessment Team • Provide technical skills and data collection, including the updating of the Town's infrastructure • Assist with the preparation and/or analysis of technical and maintenance studies • Preparing reports and tender documents using manual and computerized systems including the Unidirectional Flushing program (UDF) • Day-to-day coordination/supervision of activities related to water quality maintenance programs • Ensure compliance to MOECC standards and regulations for the Town's water distribution system • Coordinate special projects for construction/maintenance contracts • Coordinate and provide first line supervision for municipal water contracts, maintain water quality records and act as the division's contact for water quality issues • Technical assistance & cost estimating related to annual budgets and maintenance projects • Liaise with the public, property owners, builders, contractors, other departments, utilities, consultants, government agencies and other municipalities regarding matters pertaining to various Town Policies and procedures, municipal services and programs • Emergency incident reporting (AWQI, spill reports) 	
REQUIRED COMPETENCIES	
<p>QMS:</p> <ul style="list-style-type: none"> • QMS Awareness & EMS Awareness • MOECC Water Quality Analyst Certificate • Spill Response Training • Traffic Control Safety • Trench Safety • WHMIS 	<p>General:</p> <ul style="list-style-type: none"> • Two year diploma in Civil Engineering • 5 – 7years experience in municipal water distribution systems maintenance and operations, or equivalent • Demonstrated experience in a supervisory capacity • Word processing and spreadsheet software applications • Working knowledge of Occupational Health & Safety Act

DESIRED COMPETENCIES

- excellent analytical administrative, organizational, customer service, problem solving and written/oral communication skills

13. Backflow Prevention Officer

RESPONSIBILITIES

- | | |
|--|---|
| <ul style="list-style-type: none"> • Implementation, enforcement and management of backflow prevention and cross connection control program: • Inspection, approval and administrative processes • Customer service | <ul style="list-style-type: none"> • Liaising with other Town departments and other municipalities • Data entry and database maintenance for ICI water users, certified testers, property survey reports, device testing reports, and compliance status |
|--|---|

REQUIRED COMPETENCIES

- | | |
|--|---|
| <p>QMS:</p> <ul style="list-style-type: none"> • QMS Awareness • EMS Awareness • Risk Assessment • Safe Drinking Water Act | <p>General:</p> <ul style="list-style-type: none"> • Diploma in Civil Engineering • 3 – 5 years experience with water distribution and plumbing systems • Certified Technician Certification (OACETT) • Cross Connection Control Device Tester certification (OWWA) • Occupational Health & Safety Act |
|--|---|

DESIRED COMPETENCIES

- Excellent communication skills, effective customer service, computer proficiency

14. Water Technician

RESPONSIBILITIES

- Provide technical skills and data collection, including the updating of the Town’s infrastructure
- Assist with the preparation and/or analysis of technical and maintenance studies for roads, sanitary and storm sewers and water mains
- Prepare reports and tender documents using manual and computerized systems relating to residential and site plan servicing
- Coordinate special projects for construction/maintenance contracts
- Coordinate and provide first line supervision for municipal water and wastewater contracts, specifically residential and commercial service installations, curb cuts and culverts
- Maintain water, wastewater, residential infill development records
- Provide technical assistance including cost estimating, preparation of payment certificates calculating quantities; assisting in preparation of annual budgets and maintenance projects
- Liaise with the public, property owners, builders, contractors, other departments, utilities, consultants, government agencies and other municipalities regarding matters pertaining to various Town Policies and procedures, municipal services and programs

REQUIRED COMPETENCIES

- | | |
|---|---|
| <p>QMS:</p> <ul style="list-style-type: none"> • QMS Awareness & EMS Awareness • Confined Space Entry Program Elements • Construction Safety • CPR/AED Training • First Aid Certification • Spill Response Training • TJ Mahoney Road School – Const./Maint. • Traffic Control Safety • Trench Safety • WHMIS | <p>General:</p> <ul style="list-style-type: none"> • Two year (Water Tech) or three year (Works Tech) diploma in Civil Engineering • 5-7 years experience in municipal infrastructure maintenance & operations, or equivalent • Demonstrated experience in a supervisory capacity • Willingness and ability to obtain Certification as a Certified Technician (OACETT) within one year of commencing this position • word processing and spreadsheet software applications • working knowledge of Occupational Health and Safety Act • Possession of a non-restricted “G” class driver’s license in good standing and must provide a current Ontario drivers abstract from the MTO • Ability to perform all the physical demands of the job |
|---|---|

DESIRED COMPETENCIES

- Excellent oral and written communication skills
- Excellent customer service skills
- Excellent analytical administrative, organizational, and problem solving skills

15. Stock Keeper

RESPONSIBILITIES
<ul style="list-style-type: none"> Order, receive, and stock items necessary for repair and maintenance of water distribution system Ensure items are delivered and received in accordance with applicable Town standards and contract terms Ensure items are stocked in organized manner, with consideration for maintaining their accessibility and integrity Monitor inventory and register item quantities using electronic database WAMS, replenishing items to maintain adequate quantities Ensure items are signed out of stock room in accordance with approved process, billing for items as appropriate
REQUIRED COMPETENCIES
<ul style="list-style-type: none"> QMS and EMS Awareness WHMIS WAMS
DESIRED COMPETENCIES
<ul style="list-style-type: none"> Safe Drinking Water Act

C. CONSTRUCTION, DESIGN AND INSPECTION GROUP

16. Manager of Construction

RESPONSIBILITIES	
<ul style="list-style-type: none"> Prepare tender documents and administer all contracts for municipal watermain capital projects Ensure staff are certified and trained as required Liaise with contractors for municipal watermain capital projects Supervise and provide technical expertise to staff, including inspectors and surveyors Establish conditions for assumption of all servicing to be assumed into the Town's infrastructure inventory Provide yearly capital budget estimates (related to new water mains) 	
AUTHORITIES	
<ul style="list-style-type: none"> Financial authority for construction projects Staff training and certification 	<ul style="list-style-type: none"> Management authority (hire, discipline, terminate staff) Recommend projects and contractors to Council
REQUIRED COMPETENCIES	
QMS: <ul style="list-style-type: none"> QMS Awareness Competent Supervisor Confined Space Entry Elements Construction Safety Continuing Education Training – Water Operators CPR/AED Training Due Diligence First Aid Certification Media Training New Staff Orientation Training Standard Operating Procedures Traffic Control Safety Trench Safety WHMIS 	General: <ul style="list-style-type: none"> University degree in Civil Engineering Professional engineer designation Demonstrated background in construction Project Management techniques, construction methods, materials and services procurement Thorough knowledge of applicable construction law and legislation Exceptional organizational and negotiation skills Excellent oral, written and problem solving skills Proficient with database and spreadsheet software
DESIRED COMPETENCIES	
<ul style="list-style-type: none"> 9 years applicable municipal experience innovative and creative individual commitment to team building 	

17. Project Managers, Capital Infrastructure

RESPONSIBILITIES	
<ul style="list-style-type: none"> • Direct the investigative, detailed design, approval, tender, utility coordination, construction and contract administration for municipal watermain capital projects • Liaise with contractors for municipal watermain capital projects • Provide technical expertise to staff, including inspectors and surveyors • Establish conditions for assumption of all servicing to be assumed into the Town's infrastructure inventory • Assist in providing yearly capital budget estimates (related to new water mains) 	
AUTHORITIES	
<ul style="list-style-type: none"> • Limited authority for construction projects 	<ul style="list-style-type: none"> • Recommend projects and contractors to Council
REQUIRED COMPETENCIES	
<p>QMS:</p> <ul style="list-style-type: none"> • QMS Awareness • Competent Supervisor • Construction Safety • Continuing Education Training – Water Operators • CPR/AED Training • Due Diligence • First Aid Certification • Media Training • Standard Operating Procedures • Traffic Control Safety • Trench Safety • WHMIS 	<p>General:</p> <ul style="list-style-type: none"> • Demonstrated background in construction Project Management techniques, construction methods, materials and services procurement • Thorough knowledge of applicable construction law and legislation • Exceptional organizational and negotiation skills • Excellent oral, written and problem solving skills • Proficient with database and spreadsheet software
DESIRED COMPETENCIES	
<ul style="list-style-type: none"> • 5 years applicable municipal experience • innovative and creative individual • commitment to team building 	

18. Municipal Inspectors

RESPONSIBILITIES	
<ul style="list-style-type: none"> • Ensure standards for commissioning new water mains are met • Communicate with contractors to ensure procedures for sampling, swabbing, flushing, etc. are being followed • Coordinate opening and closing of valves with Maintenance & Operations staff (through Supervisor of Water & Wastewater) • Ensure water samples are delivered to York-Durham laboratory and applicable records obtained 	
REQUIRED COMPETENCIES	
<p>QMS:</p> <ul style="list-style-type: none"> • QMS Awareness • Confined Space Entry Program Elements • Construction Safety • CPR/AED Training • First Aid Certification • Spill Response Training • Traffic Control Safety • Trench Safety • WHMIS • Electrical Safety Awareness • Continuing Education Training – W&WW 	<p>General:</p> <ul style="list-style-type: none"> • High school diploma or equivalent • Minimum Operator in Training (O.I.T.) status in Water Distribution and Wastewater Collection • Achieve Ontario MOECC certification of Water Distribution Subsystem Class 1 and Wastewater Collection Class 1 within 4 years from date of hire into this position • Ontario Class DZ driver license in good standing and must provide a current Ontario drivers abstract from the M.T.O. • Construction/ maintenance of roadways, curbs, sidewalks, water distribution and wastewater collection systems • Experience and knowledge of equipment for the sanding and plowing of roads and sidewalks • Prepare, keep records; read/interpret engineering drawings • General knowledge of Occupational Health and Safety Act • Physically and medically able and competent to perform the physical demands of this position under adverse weather and site conditions, including confined space entry

DESIRED COMPETENCIES

- *See Certified Operator*

Appendix 'G': QMS Personnel Coverage Table

[Return to Table of Contents](#)

Role or Work Situation	On-Call?	Coverage	Delegated by:
Manager of Water & Wastewater	Yes	Supervisor of Water & Wastewater Director of Public Works Operations	Manager Director
Supervisor of Water & Wastewater	Yes	W&WW Technical Staff Manager of Water & Wastewater Water Foreperson	Manager Director
Water Quality Analyst	No	Supervisor and Foreperson Certified Operator	Manager Supervisor
Water Technician	No	Supervisor and Foreperson	Manager Supervisor
Water Foreperson	No	A Certified Operator is available 24 hours/day, 7 days/week (OIC) through Public Works personnel or backup service	Manager Supervisor
Certified Operator (OIC)	Yes	A Certified Operator is available 24 hours/day, 7 days/week (OIC) through Public Works personnel or backup service	Manager Supervisor
Overall-Responsible-Operator (ORO)	Yes	Supervisor acts as ORO unless otherwise delegated to Operator holding Class 2 Water Distribution (facility-level certification) Supervisor absence: Manager acts as ORO	Supervisor Manager
QMS Representative	No	Manager of Water & Wastewater Supervisor of Water & Wastewater	Manager
On-Call Schedule	-	A 'live' on-call schedule is determined by assessing staff availability and levels of competency	Supervisor
Union staff – walk-outs	-	Strike plan in place: non-unionized staff (Municipal Inspectors) and contractors to assume duties	Director and Manager

Schedule "C"

**Subject System Description Form
Municipal Residential Drinking Water System**

Owner of Municipal Residential Drinking Water System:

Name of Municipal Residential Drinking Water System:

Subject Systems			
Name of Operational Subsystems (if Applicable)	Name of Operating Authority	DWS Number(s)	
<input checked="" type="checkbox"/> Check here if the Municipal Residential Drinking Water System is operated by one operating authority. Enter the name of the operating authority in adjacent column	<input type="text" value="Town of Richmond Hill"/>	<input type="text" value="W260001968"/>	
Operational Subsystem 1:	<input type="text"/>	<input type="text"/>	<input type="text"/>
Operational Subsystem 2:	<input type="text"/>	<input type="text"/>	<input type="text"/>
Operational Subsystem 3:	<input type="text"/>	<input type="text"/>	<input type="text"/>
Operational Subsystem 4:	<input type="text"/>	<input type="text"/>	<input type="text"/>

Add attachments if there are additional 'Operational Subsystems'

Contact Information			
Name	Title	Phone Number	e-mail address
<input type="text" value="Diogo Oliveira"/>	<input type="text" value="Manager of Water and Waste Water"/>	<input type="text" value="905-884-8013 ext. 2971"/>	<input type="text" value="diogo.oliveira@richmondhill.ca"/>
<input type="text" value="Barry Kyle"/>	<input type="text" value="Supervisor of Water and Waste Water"/>	<input type="text" value="905-884-8013 ext. 2916"/>	<input type="text" value="barry.kyle@richmondhill.ca"/>