


MAP 2 - APPROVED SITE PLAN

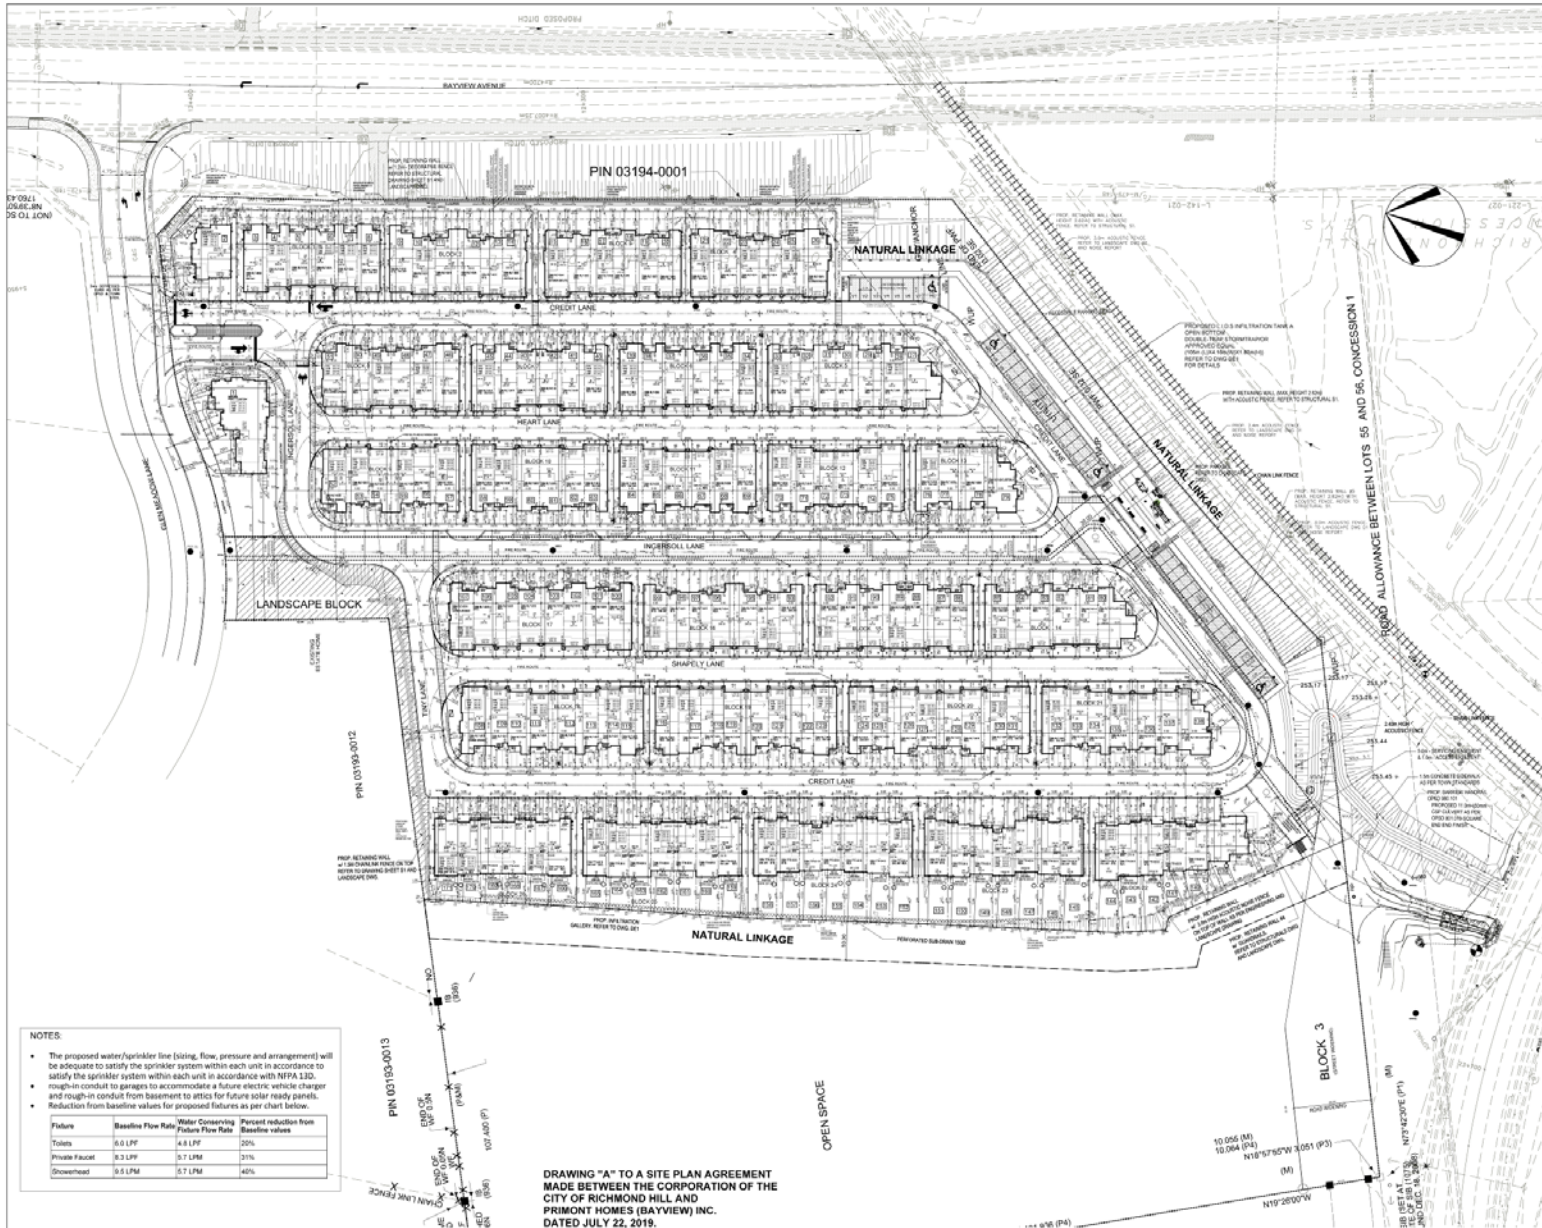

NOTES

- The proposed water/sprinkler line (sizing, flow, pressure and arrangement) will be adequate to satisfy the sprinkler system within each unit in accordance to satisfy the sprinkler system within each unit in accordance with NFPA 13B.
- rough-in conduit to garages to accommodate a future electric vehicle charger and rough-in conduit from basement to attics for future solar ready panels.
- Reduction from baseline values for proposed features as per chart below.

Feature	Baseline Flow Rate	Water Conserving Feature Flow Rate	Percent reduction from Baseline values
Toilets	6.0 LPM	4.8 LPM	20%
Private Faucet	8.2 LPM	5.7 LPM	31%
Showershead	9.5 LPM	5.7 LPM	40%

DRAWING "A" TO A SITE PLAN AGREEMENT
MADE BETWEEN THE CORPORATION OF THE
CITY OF RICHMOND HILL AND
PRIMONT HOMES (BAYVIEW) INC.
DATED JULY 22, 2019.

BLOCK 10 FILE No. D05-15001

**CITY OF RICHMOND HILL
PLANNING AND REGULATORY
SERVICES DEPARTMENT**